


IMBALANCES

Electricity


Gas

System Imbalance

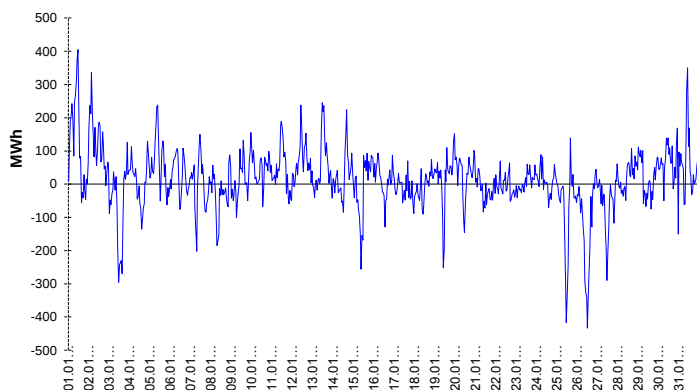

	Volume (GWh)	Average Volume (MWh/hod)
Positive Imbalance	98,08	131,8
Negative Imbalance	-87,14	-117,1
Total Cost of Regulating Energy (CZK):		62 842 441,40

System Imbalance

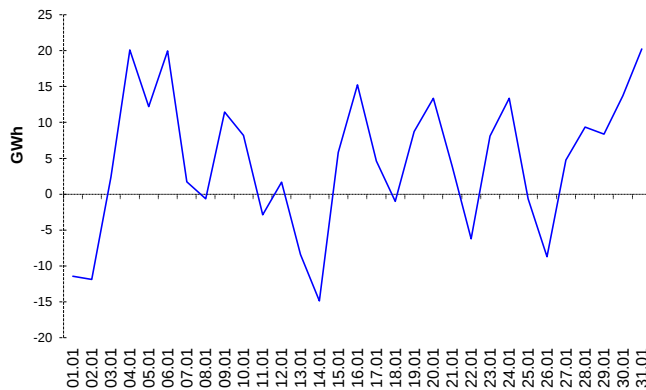


	Volume (GWh)
Positive Imbalance	338,84
Negative Imbalance	-198,23
Gas settled in kind for physical balancing	99,85
Flexibility service balance	23,95

REGISTRATION DATA

Registered Market Participants - electricity and gas	17 924
Subjects of Settlement - electricity	99
Subjects of Settlement - gas	56

Average Daily Temperature

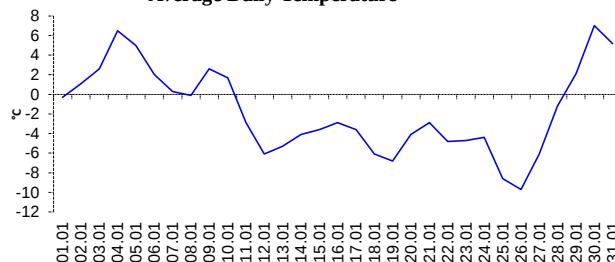

Changes of Supplier	67 548
Total Amount of Registered OPMs	1 115 041


Changes of Supplier	36 646
Total Amount of Registered OPMs	771 822

SHORT-TERM MARKETS

Electricity	Volume (MWh)	Average Price
Block Market	396,0	1349,33 Kč/MWh
Day-Ahead M. - Sell	819 476,6	41,43 EUR/MWh
Day-Ahead M. - Purchase	889 117,5	
Intraday Market	35 001,8	942,49 Kč/MWh

Gas	Volume (MWh)	Average Price (EUR/MWh)
Day-Ahead Market	0,0	0,00
Intraday Market	34863,0	27,51

SPOT MARKET INDEX

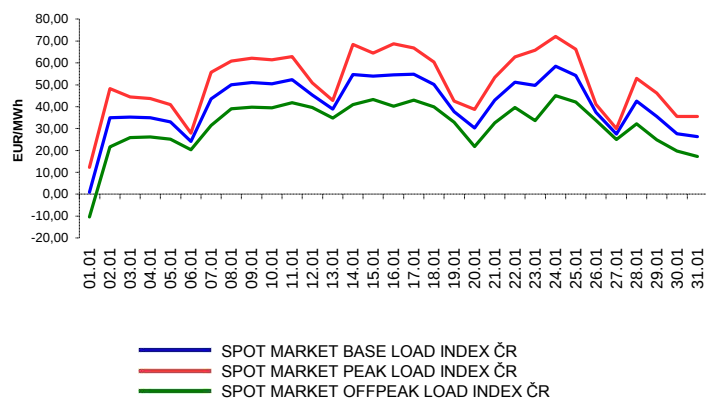

REGISTRY FOR GREENHOUSE GAS EMISSION ALLOWANCE TRADING

Transaction Type	Unit Volumes	No. of Transactions
EU Allowances	7 058 622	47
Kyoto units	18 216 865	48
Sum	25 275 487	95

Note:

The data is valid to the last day of the calendar month and may vary according to the version of the settlement of imbalances.

OPM - The point of delivery and transfer registered in the OTE's system in case of the first change of supplier. Number of changes of supplier reflects the total number of delivery points, on which change of supplier occurred.

More Information is available on <http://www.ote-cr.cz>