


IMBALANCES

Electricity


Gas

System Imbalance

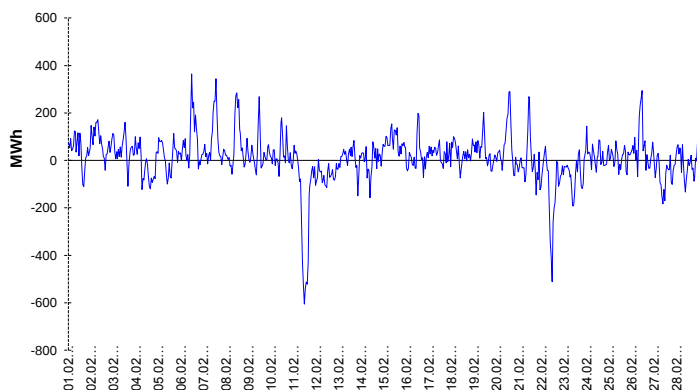

	Volume (GWh)	Average Volume (MWh/hod)
Positive Imbalance	77,83	115,8
Negative Imbalance	-70,10	-104,3
Total Cost of Regulating Energy (CZK):		59 477 373,40

System Imbalance

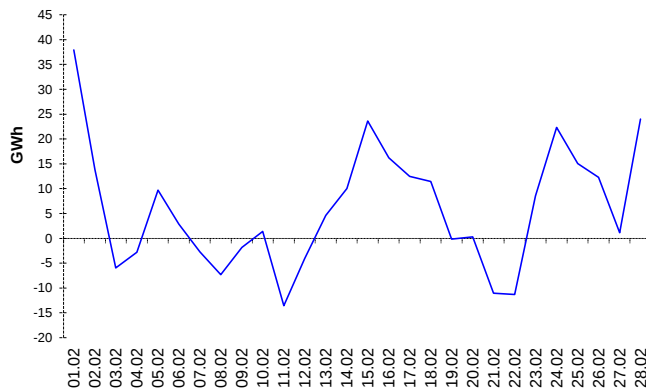


	Volume (GWh)
Positive Imbalance	316,83
Negative Imbalance	-149,55
Gas settled in kind for physical balancing	138,22
Flexibility service balance	100,00

REGISTRATION DATA

Registered Market Participants - electricity and gas	24 056
Subjects of Settlement - electricity	98
Subjects of Settlement - gas	58

Average Daily Temperature

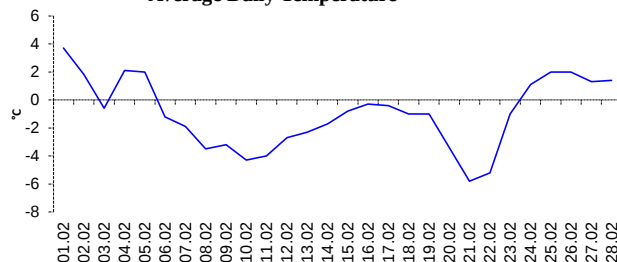

Changes of Supplier	24 791
Total Amount of Registered OPMs	1 129 533


Changes of Supplier	33 824
Total Amount of Registered OPMs	799 097

SHORT-TERM MARKETS

Electricity	Volume (MWh)	Average Price
Block Market	1 392,0	1188,03 Kč/MWh
Day-Ahead M. - Sell	722 742,4	42,67 EUR/MWh
Day-Ahead M. - Purchase	856 324,0	
Intraday Market	29 126,2	1020,32 Kč/MWh

Gas	Volume (MWh)	Average Price (EUR/MWh)
Day-Ahead Market	0,0	0,00
Intraday Market	20826,5	26,81

SPOT MARKET INDEX

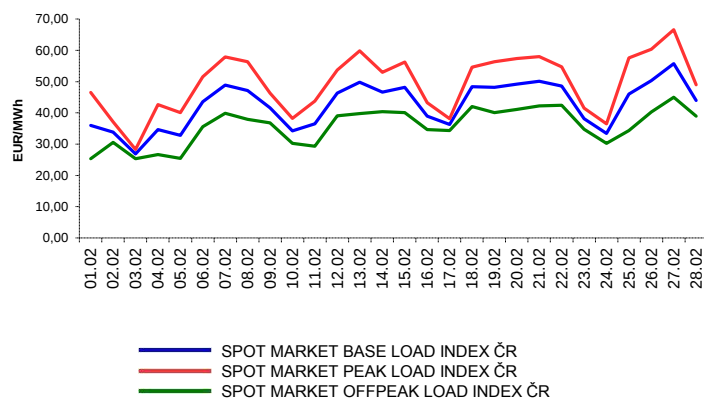

REGISTRY FOR GREENHOUSE GAS EMISSION ALLOWANCE TRADING

Transaction Type	Unit Volumes	No. of Transactions
EU Allowances	1 501 826	25
Kyoto units	686 794	25
Sum	2 188 620	50

Note:

The data is valid to the last day of the calendar month and may vary according to the version of the settlement of imbalances.

OPM - The point of delivery and transfer registered in the OTE's system in case of the first change of supplier. Number of changes of supplier reflects the total number of delivery points, on which change of supplier occurred.

More Information is available on <http://www.ote-cr.cz>