


IMBALANCES

Electricity


Gas

System Imbalance

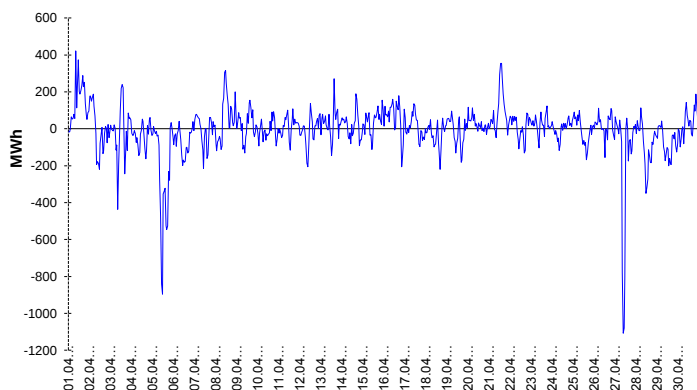

	Volume (GWh)	Average Volume (MWh/hod)
Positive Imbalance	90,22	125,3
Negative Imbalance	-94,60	-131,4
Total Cost of Regulating Energy (CZK):		99 956 500,70

System Imbalance

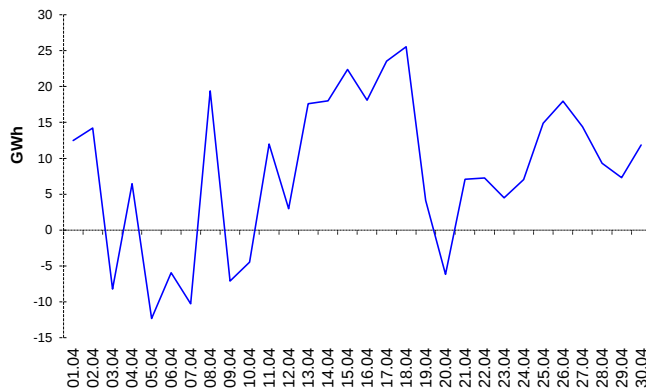


	Volume (GWh)
Positive Imbalance	403,01
Negative Imbalance	-159,04
Gas settled in kind for physical balancing	243,40
Flexibility service balance	-5,80

REGISTRATION DATA

Registered Market Participants - electricity and gas	24 366
Subjects of Settlement - electricity	95
Subjects of Settlement - gas	59

Changes of Supplier	29 297
Total Amount of Registered OPMs	1 162 556

Average Daily Temperature

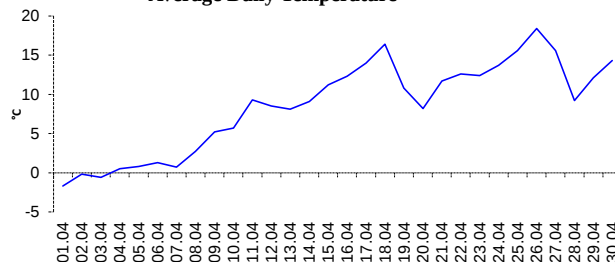


Changes of Supplier	23 871
Total Amount of Registered OPMs	838 190

SHORT-TERM MARKETS

Electricity	Volume (MWh)	Average Price
Block Market	2 040,0	1075,24 Kč/MWh
Day-Ahead M. - Sell	858 171,8	36,67 EUR/MWh
Day-Ahead M. - Purchase	1 069 080,1	
Intraday Market	34 511,9	1066,12 Kč/MWh

Gas	Volume (MWh)	Average Price (EUR/MWh)
Day-Ahead Market	0,0	0,00
Intraday Market	15600,8	30,88

SPOT MARKET INDEX

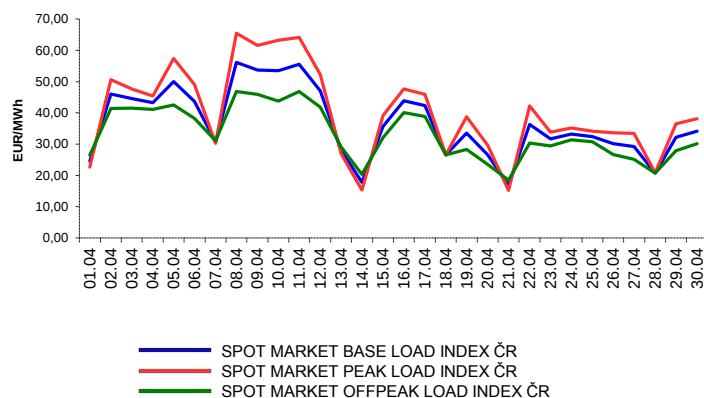

REGISTRY FOR GREENHOUSE GAS EMISSION ALLOWANCE TRADING

Transaction Type	Unit Volumes	No. of Transactions
EU Allowances	9 530 375	172
Kyoto units	2 117 547	134
Sum	11 647 922	306

Note:

The data is valid to the last day of the calendar month and may vary according to the version of the settlement of imbalances.

OPM - The point of delivery and transfer registered in the OTE's system in case of the first change of supplier. Number of changes of supplier reflects the total number of delivery points, on which change of supplier occurred.

More Information is available on <http://www.ote-cr.cz>