


IMBALANCES

Electricity


Gas

System Imbalance

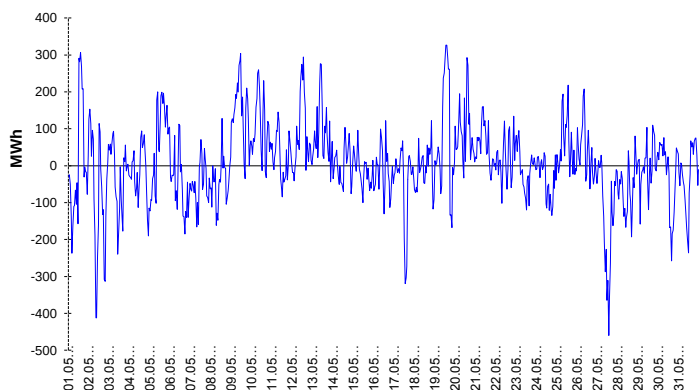

	Volume (GWh)	Average Volume (MWh/hod)
Positive Imbalance	91,69	123,2
Negative Imbalance	-86,63	-116,4
Total Cost of Regulating Energy (CZK):		78 878 157,60

System Imbalance

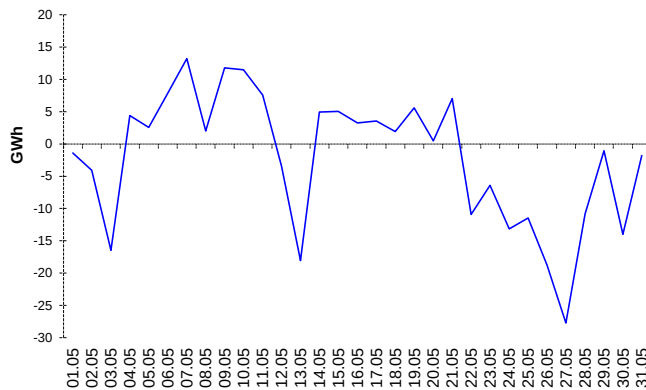


	Volume (GWh)
Positive Imbalance	191,27
Negative Imbalance	-258,25
Gas settled in kind for physical balancing	-32,58
Flexibility service balance	107,00

REGISTRATION DATA

Registered Market Participants - electricity and gas	24 715
Subjects of Settlement - electricity	93
Subjects of Settlement - gas	61

Changes of Supplier	28 862
Total Amount of Registered OPMs	1 178 473

Average Daily Temperature

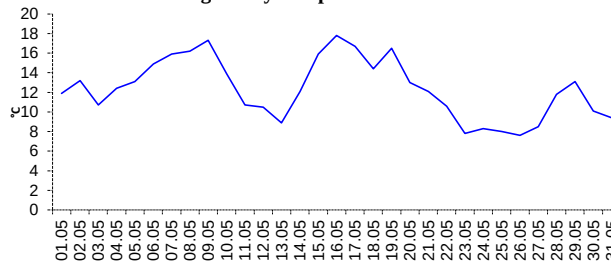


Changes of Supplier	25 075
Total Amount of Registered OPMs	854 118

SHORT-TERM MARKETS

Electricity	Volume (MWh)	Average Price
Block Market	60,0	520 Kč/MWh
Day-Ahead M. - Sell	878 851,4	28,51 EUR/MWh
Day-Ahead M. - Purchase	1 034 431,6	
Intraday Market	30 363,4	986,19 Kč/MWh

Gas	Volume (MWh)	Average Price (EUR/MWh)
Day-Ahead Market	0,0	0,00
Intraday Market	17815,0	27,21

SPOT MARKET INDEX

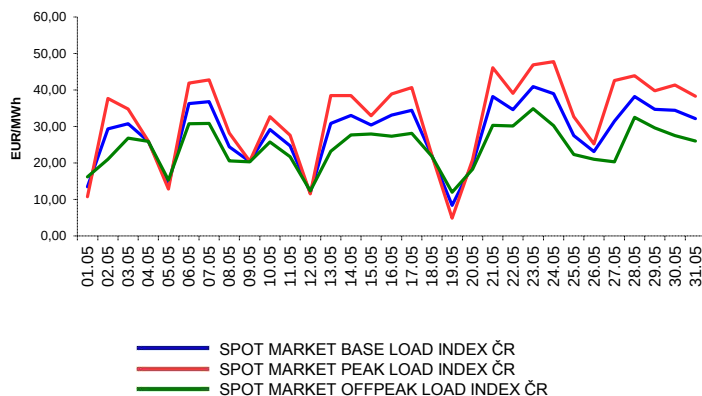

REGISTRY FOR GREENHOUSE GAS EMISSION ALLOWANCE TRADING

Transaction Type	Unit Volumes	No. of Transactions
EU Allowances	11 461 003	88
Kyoto units	2 737 370	13
Sum	14 198 373	101

Note:

The data is valid to the last day of the calendar month and may vary according to the version of the settlement of imbalances.

OPM - The point of delivery and transfer registered in the OTE's system in case of the first change of supplier. Number of changes of supplier reflects the total number of delivery points, on which change of supplier occurred.

More Information is available on <http://www.ote-cr.cz>