


IMBALANCES


Electricity

Gas

System Imbalance

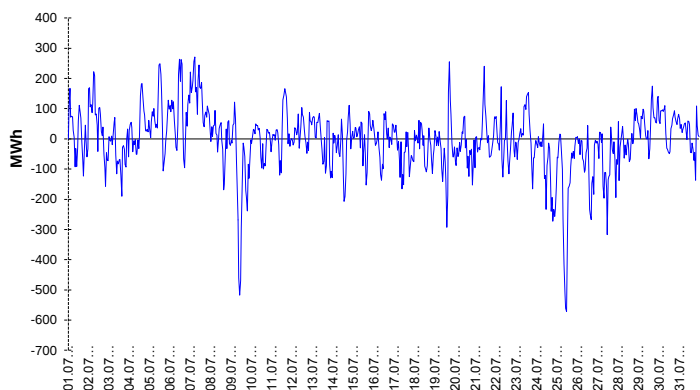

System Imbalance

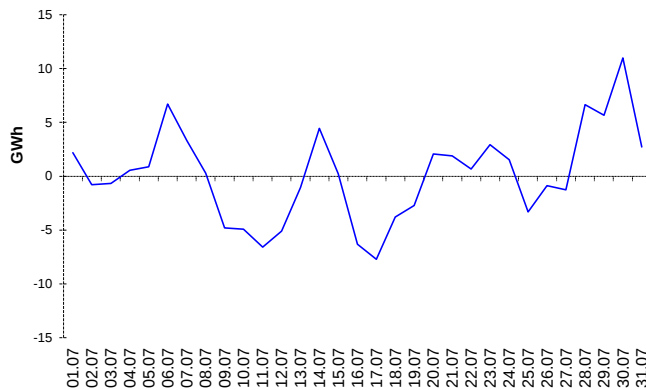

	Volume (GWh)	Average Volume (MWh/hod)
Positive Imbalance	79,27	106,6
Negative Imbalance	-82,62	-111,0
Total Cost of Regulating Energy (CZK):		76 106 224,00

	Volume (GWh)
Positive Imbalance	134,78
Negative Imbalance	-137,31
Gas settled in kind for physical balancing	-17,70
Flexibility service balance	27,00

REGISTRATION DATA


Registered Market Participants - electricity and gas	6 514
Subjects of Settlement - electricity	94
Subjects of Settlement - gas	48

Changes of Supplier	30 726
Total Amount of Registered OPMs	945 168

SHORT-TERM MARKETS


Electricity	Volume (MWh)	Average Price
Block Market	0,0	0 Kč/MWh
Day-Ahead M. - Sell	922 123,7	40,64 EUR/MWh
Day-Ahead M. - Purchase	882 874,7	
Intraday Market	21 629,3	1137,07 Kč/MWh

Average Daily Temperature

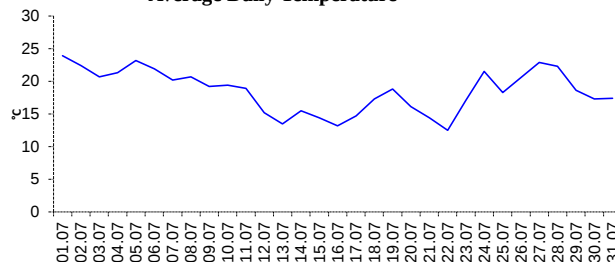

Changes of Supplier	26 272
Total Amount of Registered OPMs	636 806

SPOT MARKET INDEX

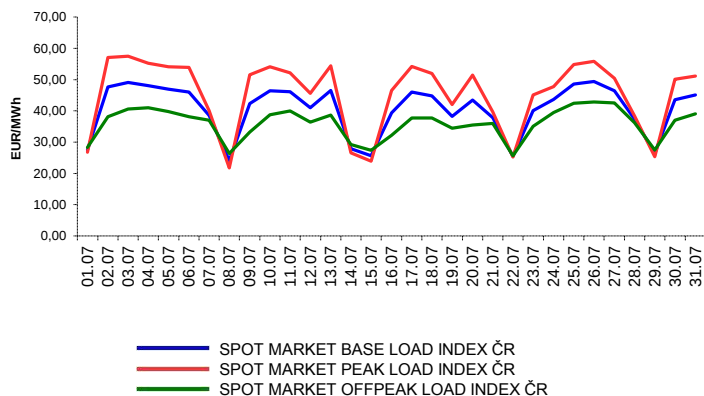

REGISTRY FOR GREENHOUSE GAS EMISSION ALLOWANCE TRADING

Transaction Type	Unit Volumes	No. of Transactions
EU Allowances	4 804 983	40
Kyoto units	646 654	18
Sum	5 451 637	58

Note:

The data is valid to the last day of the calendar month and may vary according to the version of the settlement of imbalances.

OPM - The point of delivery and transfer registered in the OTE's system in case of the first change of supplier. Number of changes of supplier reflects the total number of delivery points, on which change of supplier occurred.

More Information is available on <http://www.ote-cr.cz>