


IMBALANCES

Electricity


Gas

System Imbalance

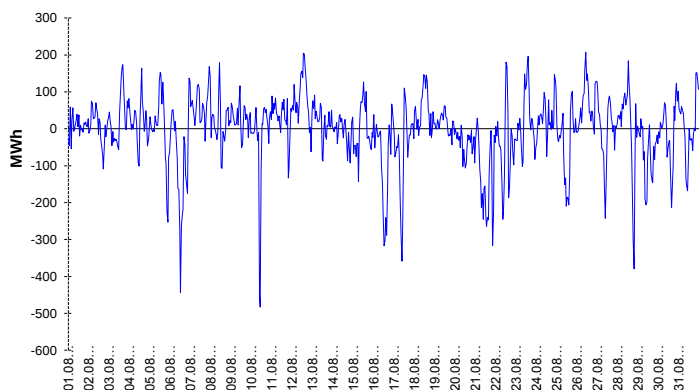

	Volume (GWh)	Average Volume (MWh/hod)
Positive Imbalance	74,01	99,5
Negative Imbalance	-76,13	-102,3
Total Cost of Regulating Energy (CZK):		67 625 580,60

System Imbalance

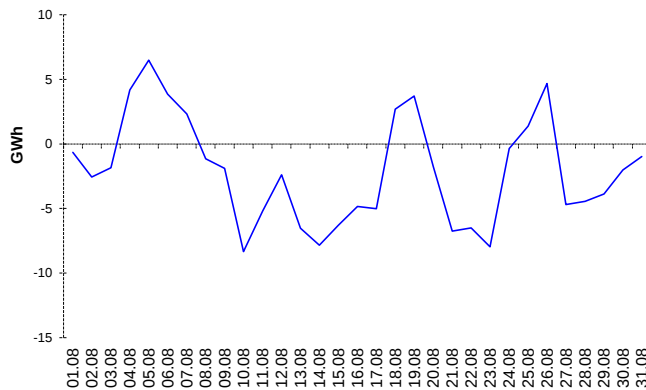


	Volume (GWh)
Positive Imbalance	91,82
Negative Imbalance	-156,53
Gas settled in kind for physical balancing	-49,95
Flexibility service balance	-30,00

REGISTRATION DATA

Registered Market Participants - electricity and gas	6 675
Subjects of Settlement - electricity	94
Subjects of Settlement - gas	48

Changes of Supplier	25 147
Total Amount of Registered OPMs	963 473

Average Daily Temperature

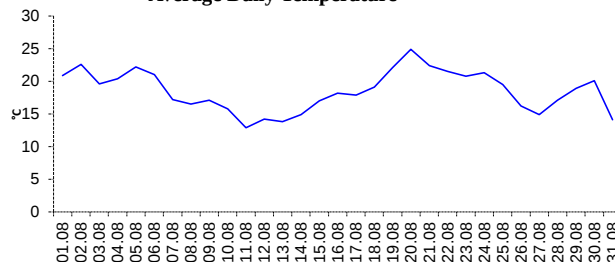


Changes of Supplier	27 725
Total Amount of Registered OPMs	661 412

SHORT-TERM MARKETS

Electricity	Volume (MWh)	Average Price
Block Market	2 664,0	1295,77 Kč/MWh
Day-Ahead M. - Sell	1 147 658,2	45,28 EUR/MWh
Day-Ahead M. - Purchase	874 399,9	
Intraday Market	22 813,0	1091,94 Kč/MWh

Gas	Volume (MWh)	Average Price (EUR/MWh)
Day-Ahead Market	0,0	0,00
Intraday Market	5929,3	24,01

SPOT MARKET INDEX

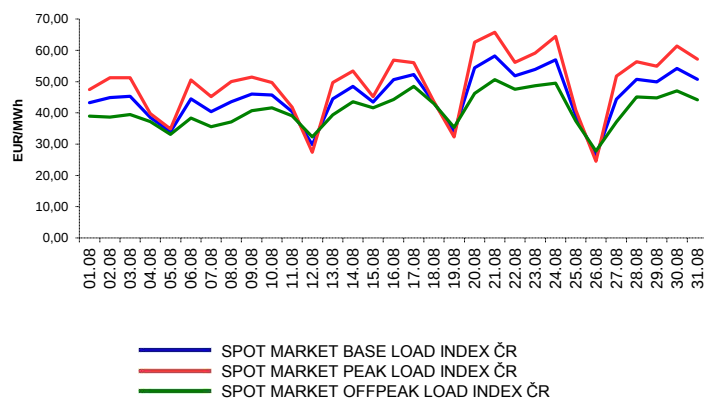

REGISTRY FOR GREENHOUSE GAS EMISSION ALLOWANCE TRADING

Transaction Type	Unit Volumes	No. of Transactions
EU Allowances	669 042	34
Kyoto units	210 640	30
Sum	879 682	64

Note:

The data is valid to the last day of the calendar month and may vary according to the version of the settlement of imbalances.

OPM - The point of delivery and transfer registered in the OTE's system in case of the first change of supplier. Number of changes of supplier reflects the total number of delivery points, on which change of supplier occurred.

More Information is available on <http://www.ote-cr.cz>