


IMBALANCES

Electricity


Gas

System Imbalance

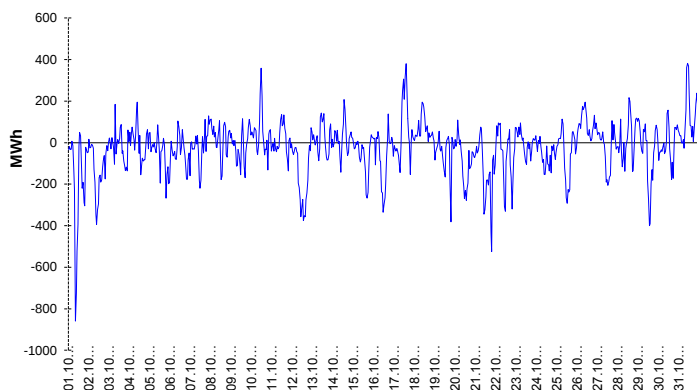

	Volume (GWh)	Average Volume (MWh/hod)
Positive Imbalance	86,42	116,0
Negative Imbalance	-105,28	-141,3
Total Cost of Regulating Energy (CZK):		123 181 816,80

System Imbalance

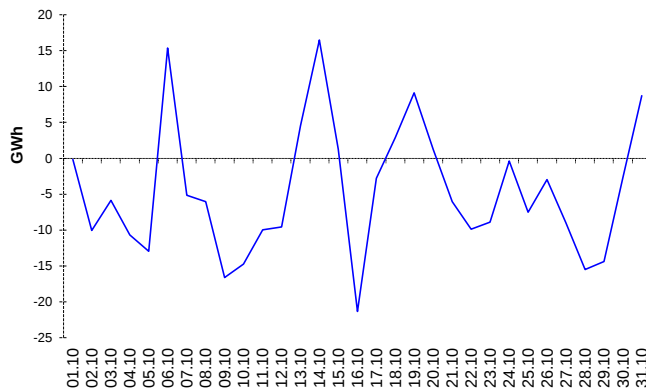


	Volume (GWh)
Positive Imbalance	184,93
Negative Imbalance	-328,43
Gas settled in kind for physical balancing	-125,85
Flexibility service balance	-55,00

REGISTRATION DATA

Registered Market Participants - electricity and gas	7 070
Subjects of Settlement - electricity	96
Subjects of Settlement - gas	51

Changes of Supplier	29 769
Total Amount of Registered OPMs	1 007 656

Average Daily Temperature

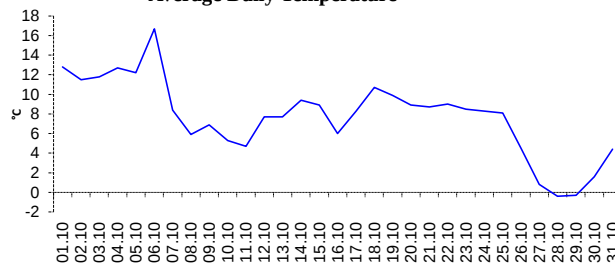


Changes of Supplier	26 455
Total Amount of Registered OPMs	705 398

SHORT-TERM MARKETS

Electricity	Volume (MWh)	Average Price
Block Market	1 680,0	1229,29 Kč/MWh
Day-Ahead M. - Sell	974 917,4	44,04 EUR/MWh
Day-Ahead M. - Purchase	889 077,3	
Intraday Market	33 881,6	1235,16 Kč/MWh

Gas	Volume (MWh)	Average Price (EUR/MWh)
Day-Ahead Market	0,0	0,00
Intraday Market	5428,8	26,76

SPOT MARKET INDEX

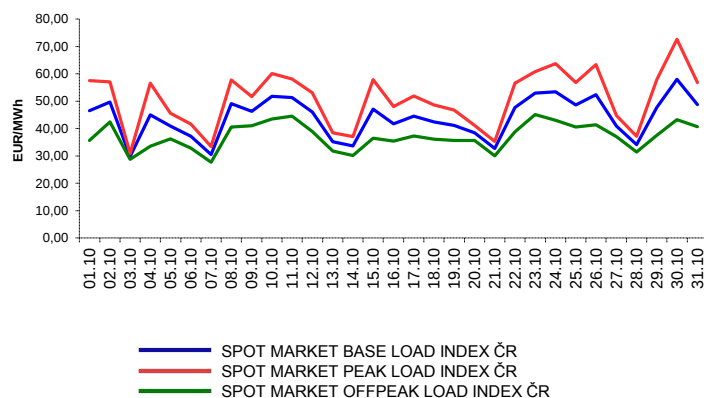

REGISTRY FOR GREENHOUSE GAS EMISSION ALLOWANCE TRADING

Transaction Type	Unit Volumes	No. of Transactions
EU Allowances	3 524 519	45
Kyoto units	94 146	14
Sum	3 618 665	59

Note:

The data is valid to the last day of the calendar month and may vary according to the version of the settlement of imbalances.

OPM - The point of delivery and transfer registered in the OTE's system in case of the first change of supplier. Number of changes of supplier reflects the total number of delivery points, on which change of supplier occurred.

More Information is available on <http://www.ote-cr.cz>