


IMBALANCES

Electricity


Gas

System Imbalance

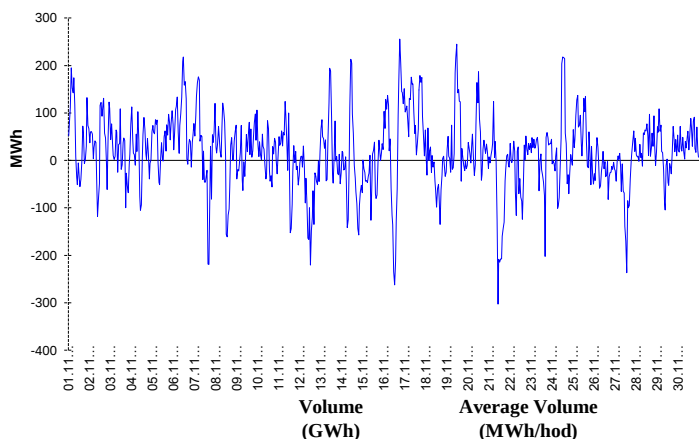

	Volume (GWh)	Average Volume (MWh/hod)
Positive Imbalance	79,64	110,6
Negative Imbalance	-67,80	-94,2
Total Cost of Regulating Energy (CZK):		52 411 535,90

System Imbalance

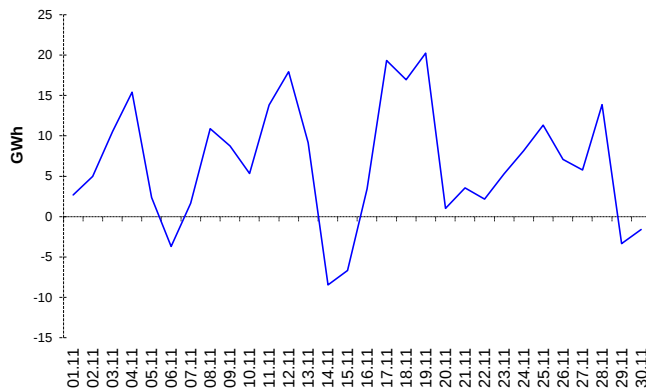


	Volume (GWh)
Positive Imbalance	319,56
Negative Imbalance	-120,66
Gas settled in kind for physical balancing	190,87
Flexibility service balance	-206,35

REGISTRATION DATA

Registered Market Participants - electricity and gas	7 950
Subjects of Settlement - electricity	97
Subjects of Settlement - gas	52

Changes of Supplier	52 287
Total Amount of Registered OPMs	1 049 778

Average Daily Temperature

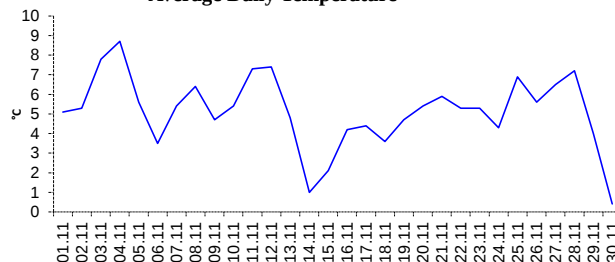


Changes of Supplier	27 926
Total Amount of Registered OPMs	725 178

SHORT-TERM MARKETS

Electricity	Volume (MWh)	Average Price
Block Market	8 400,0	1306,21 Kč/MWh
Day-Ahead M. - Sell	884 163,7	44,29 EUR/MWh
Day-Ahead M. - Purchase	990 025,0	
Intraday Market	20 932,8	1086,63 Kč/MWh

Gas	Volume (MWh)	Average Price (EUR/MWh)
Day-Ahead Market	0,0	0,00
Intraday Market	5523,9	27,55

SPOT MARKET INDEX

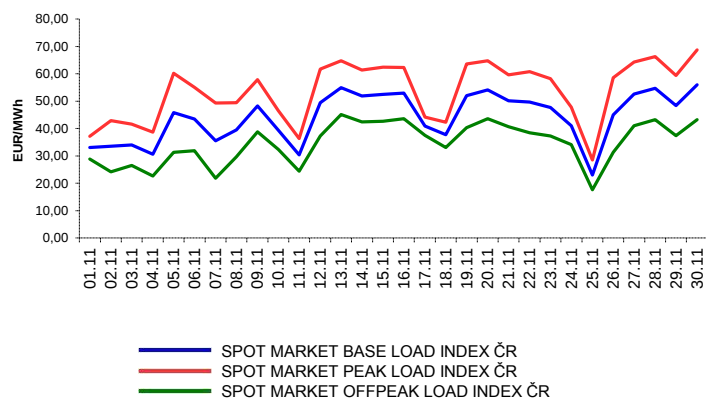

REGISTRY FOR GREENHOUSE GAS EMISSION ALLOWANCE TRADING

Transaction Type	Unit Volumes	No. of Transactions
EU Allowances	19 675 287	99
Kyoto units	1 512 425	28
Sum	21 187 712	127

Note:

The data is valid to the last day of the calendar month and may vary according to the version of the settlement of imbalances.

OPM - The point of delivery and transfer registered in the OTE's system in case of the first change of supplier. Number of changes of supplier reflects the total number of delivery points, on which change of supplier occurred.

More Information is available on <http://www.ote-cr.cz>