


IMBALANCES

Electricity


Gas

System Imbalance

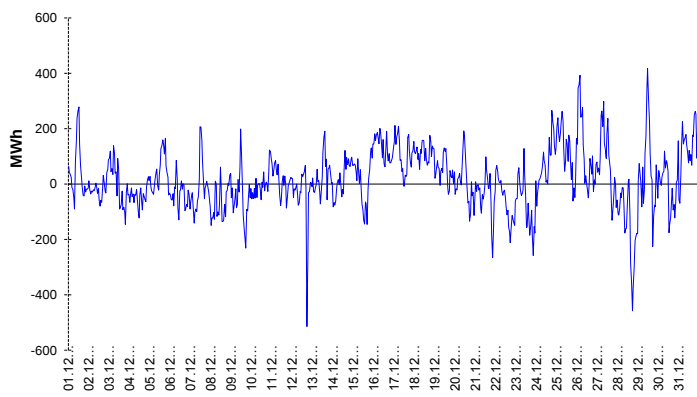

	Volume (GWh)	Average Volume (MWh/hod)
Positive Imbalance	109,81	147,6
Negative Imbalance	-96,32	-129,5
Total Cost of Regulating Energy (CZK):		74 234 166,80

System Imbalance

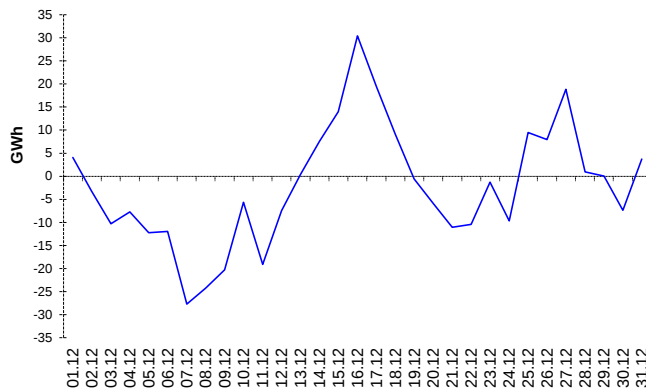


	Volume (GWh)
Positive Imbalance	275,26
Negative Imbalance	-345,59
Gas settled in kind for physical balancing	-69,29
Flexibility service balance	72,00

REGISTRATION DATA

Registered Market Participants - electricity and gas	17 924
Subjects of Settlement - electricity	99
Subjects of Settlement - gas	55

Average Daily Temperature

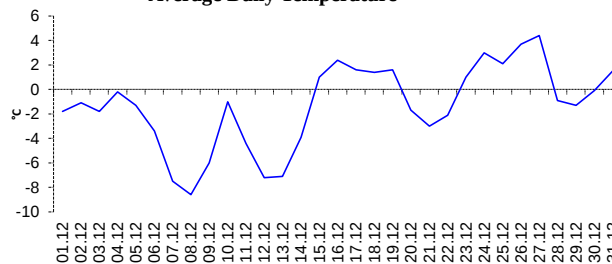

Changes of Supplier	39 219
Total Amount of Registered OPMs	1 080 710


Changes of Supplier	28 094
Total Amount of Registered OPMs	747 843

SHORT-TERM MARKETS

Electricity	Volume (MWh)	Average Price
Block Market	4 080,0	1451,65 Kč/MWh
Day-Ahead M. - Sell	871 258,0	36,3 EUR/MWh
Day-Ahead M. - Purchase	971 178,3	
Intraday Market	28 249,4	917,3 Kč/MWh

Gas	Volume (MWh)	Average Price (EUR/MWh)
Day-Ahead Market	0,0	0,00
Intraday Market	5601,7	28,19

SPOT MARKET INDEX

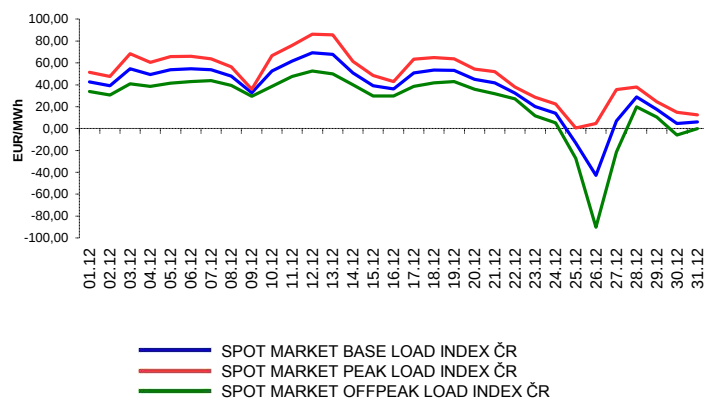

REGISTRY FOR GREENHOUSE GAS EMISSION ALLOWANCE TRADING

Transaction Type	Unit Volumes	No. of Transactions
EU Allowances	44 926 556	149
Kyoto units	28 299 259	258
Sum	73 225 815	407

Note:

The data is valid to the last day of the calendar month and may vary according to the version of the settlement of imbalances.

OPM - The point of delivery and transfer registered in the OTE's system in case of the first change of supplier. Number of changes of supplier reflects the total number of delivery points, on which change of supplier occurred.

More Information is available on <http://www.ote-cr.cz>